

Advanced Soft Computing Techniques for Enhancing Power System Performance and Optimization

¹ Km Arti, ² Vikas Sharma, ¹ Sharad Kumar

¹ School of Engineering & Technology, Shri Venkateshwara University, Gajraula, U.P. India

² Department of Computer Applications, SRM Institute of Science and Technology, Delhi NCR Campus, Ghaziabad, U.P. India

DOI : <https://doi.org/10.51583/IJLTEMAS.2025.1412000069>

Received: 19 December 2025; Accepted: 24 December 2025; Published: 05 January 2026

ABSTRACT


The increasing complexity and dynamic nature of modern power systems demand advanced optimization techniques to ensure reliable, efficient, and cost-effective operation. This paper explores the development and application of soft computing techniques, including fuzzy logic, genetic algorithms, and artificial neural networks, for enhancing power system performance and optimization. By integrating these intelligent computational approaches, the study addresses challenges such as load balancing, economic dispatch, voltage stability, and fault management. Simulation results demonstrate that soft computing-based methods outperform conventional optimization techniques in terms of accuracy, convergence speed, and adaptability to changing system conditions. The proposed framework provides a robust and flexible solution for real-time power system optimization, contributing to improved operational efficiency and sustainability.

Keywords—Soft Computing, Power System Optimization, Fuzzy Logic, Genetic Algorithms, Artificial Neural Networks, Load Balancing, Voltage Stability, Economic Dispatch.

INTRODUCTION

The modern power system is undergoing a rapid transformation driven by increasing demand, integration of renewable energy sources, deregulation of electricity markets, and the emergence of smart grid technologies. These developments have introduced significant challenges in the operation, control, and optimization of power systems. Traditionally, power system optimization relied on conventional mathematical methods, such as linear programming, quadratic programming, and gradient-based techniques, which assume precise system models and deterministic conditions. However, the inherent uncertainties in load demand, generation capacity, renewable energy variability, and network contingencies often limit the effectiveness of these conventional approaches. Consequently, there is a growing need for intelligent, adaptive, and robust optimization methods capable of handling the complex, nonlinear, and uncertain characteristics of modern power systems. Soft computing techniques, which encompass methodologies such as fuzzy logic, genetic algorithms, particle swarm optimization, artificial neural networks, and hybrid intelligent systems, have emerged as promising alternatives to conventional optimization strategies. These techniques are characterized by their ability to model imprecise, uncertain, and nonlinear system behavior, making them highly suitable for power system applications. Fuzzy logic provides a mechanism for handling linguistic uncertainty and expert knowledge, while evolutionary algorithms, such as genetic algorithms, facilitate global search and optimization in complex, multimodal solution spaces. Artificial neural networks enable learning and prediction capabilities, allowing adaptive control and real-time decision-making. By leveraging these techniques, power system engineers can address multiple operational objectives simultaneously, including minimizing generation cost, reducing transmission losses, enhancing voltage stability, and improving system reliability. In recent years, several studies have demonstrated the effectiveness of soft computing in solving diverse power system optimization problems. For instance, economic dispatch, which involves determining the optimal generation levels of various power units to meet load demand at minimal cost, has been extensively addressed using genetic algorithms and particle swarm optimization. Similarly, fuzzy logic controllers have been successfully

applied to voltage and frequency regulation, load forecasting, and reactive power management. Hybrid approaches that combine multiple soft computing techniques often achieve superior performance by exploiting the complementary strengths of individual methods. Despite these advances, challenges remain in terms of computational complexity, convergence speed, scalability, and adaptability to real-time operating conditions. Addressing these challenges requires the development of enhanced algorithms, efficient computational frameworks, and integrated models tailored to the specific characteristics of modern power networks. The primary motivation of this paper is to investigate advanced soft computing techniques and their applications in power system performance optimization. The study focuses on developing intelligent optimization strategies that can simultaneously address multiple system objectives while accommodating uncertainties in generation and load. By conducting a comprehensive analysis and simulation-based evaluation, the paper aims to demonstrate the effectiveness of these techniques in enhancing system efficiency, reliability, and stability. Furthermore, the research emphasizes the practical implementation of these methods in real-time power system operation, highlighting their potential to support decision-making, facilitate smart grid management, and promote sustainable energy utilization shown in Fig. 1.

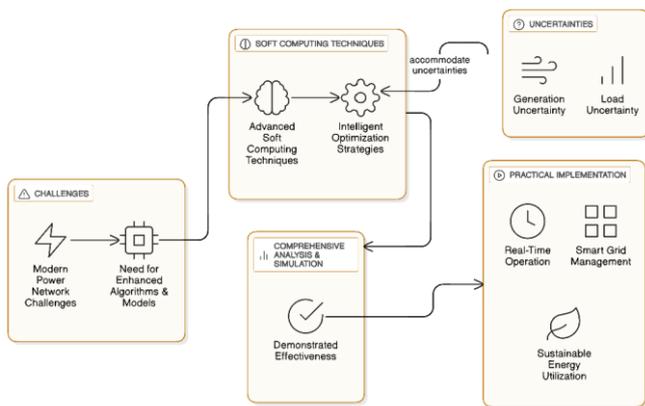

Soft Computing Techniques for Power System Optimization

The remainder of the paper is structured as follows: Section II presents a review of existing soft computing techniques and their applications in power system optimization. Section III describes the methodology adopted, including the design of fuzzy logic systems, genetic algorithm-based optimization, and hybrid models. Section IV discusses the simulation results, performance evaluation, and comparative analysis with conventional techniques. Finally, Section V concludes the paper by summarizing key findings, practical implications, and future research directions in the field of intelligent power system optimization.

LITERATURE REVIEW

Recent research demonstrates the significant potential of soft computing techniques in enhancing power system performance, optimization, and stability. Swarnkar et al. [1] investigated the application of soft computing techniques for improving power quality and forecasting in hybrid photovoltaic systems connected to the grid. The study emphasized the ability of fuzzy logic and neural network-based approaches to handle uncertainties in solar generation and load demand, resulting in improved system reliability and power quality. Sravankumar et al. [2] focused on maximum power point tracking (MPPT) for solar photovoltaic systems using soft computing methods. The research highlighted the advantages of intelligent algorithms, such as genetic algorithms and particle swarm optimization, in accurately tracking the maximum power point under varying environmental conditions, thereby enhancing energy efficiency. Similarly, Ren [3] proposed an optimized configuration model for wind power systems with energy storage using an OOB-GWO-SVR approach. This study illustrated how hybrid soft computing models can effectively balance renewable energy integration and storage optimization, reduce operational costs and improve system stability. Kumar and Kataria [4] implemented soft computing-based optimization strategies to enhance power system stability. Their work demonstrated that fuzzy logic controllers and evolutionary algorithms could mitigate system oscillations and maintain voltage and frequency stability under disturbances. In parallel, Emmadi et al. [5] extended the application of advanced optimization techniques to resource allocation in edge computing networks, reflecting the versatility of soft computing

methods across distributed and intelligent networked systems. Sai Kalyan et al. [6] applied the Fruit Fly Optimization Algorithm for load frequency control (LFC) in conventional power systems with integrated plug-in electric vehicles. The study underscored the effectiveness of bio-inspired algorithms in handling non-linear, multi-objective optimization challenges in dynamic power system environments. Rajak et al. [7] proposed a TOPSIS-aided multi-objective artificial vulture optimization algorithm to solve combined economic and emission dispatch problems, highlighting the relevance of multi-objective optimization for sustainable and cost-effective power system operation. Banerjee et al. [8] addressed the optimal power flow problem in hybrid power systems using a Laplacian mutual learning-assisted backtracking search algorithm. Their findings confirmed that advanced soft computing approaches can improve convergence speed and solution accuracy compared to conventional methods. Vivek et al. [9] developed a novel flying capacitor multilevel inverter with reduced components and harmonic mitigation using soft computing techniques, demonstrating the practical applicability of these methods in power electronics and inverter design. Kanth and Gupta [10] provided a comprehensive review of MPPT methods for photovoltaic systems, emphasizing the superiority of soft computing-based approaches over classical techniques in terms of efficiency, adaptability, and robustness under partial shading and environmental uncertainties. Zhao and Feng [11] evaluated active optimization strategies for HPLC frequency bands using soft computing models, showing their effectiveness in dynamic system control and regional adaptability. Sumathi et al. [12] analysed distinctive DC-DC power converters for standalone solar water pumps, employing soft computing techniques to enhance operational efficiency and performance under variable conditions. Pandey and Mahia [13] proposed a hybrid LQR controller optimized with PSO and TLBO algorithms for single-area load frequency control in systems incorporating renewable energy, highlighting the benefits of hybrid optimization approaches in improving dynamic response and robustness. Kalyan et al. [14] introduced the Donkey and Smuggler algorithm-tuned IDDF controller for multi-area power system stability with HVDC links. Their study reinforced the applicability of intelligent algorithms in complex multi-area power networks to maintain voltage and frequency stability. Dugaya et al. [15] focused on power loss minimization in distributed generation allocation using artificial intelligence techniques, demonstrating significant reduction in transmission losses and improved system efficiency.

PROPOSED METHODOLOGY

The proposed methodology presents a structured and systematic framework to analyze the application of soft computing techniques in power system optimization. The methodology is organized into well-defined phases to ensure accurate modeling, controlled simulation, performance evaluation, and effective optimization of power system parameters. The following steps outline the complete methodological approach adopted in this study.

1. Selection and Modeling of Power System: The methodology begins with the selection of a benchmark power system, such as the IEEE 30-bus or 57-bus test system, for analysis. These systems are widely used in research due to their complexity, scalability, and relevance to real-world power networks. System components including generators, transformers, transmission lines, and loads are modelled using appropriate electrical parameters. This step establishes a baseline representation of the power system, capturing operational characteristics such as generation capacity, load demand, network topology, and bus voltage profiles. Accurate modeling ensures reliable simulation and effective evaluation of optimization strategies.

2. Identification of Optimization Objectives and Constraints: In the next phase, critical optimization objectives are defined, including economic dispatch, voltage stability, loss minimization, and load balancing. Operational constraints such as generator limits, bus voltage limits, line flow limits, and power balance conditions are also incorporated. These objectives and constraints form the foundation of the optimization problem, ensuring that the proposed soft computing methods address both efficiency and reliability in power system operation.

3. Selection of Soft Computing Techniques: A set of advanced soft computing techniques is selected based on their suitability for solving nonlinear and complex power system optimization problems. These include:

- **Fuzzy Logic (FL):** for handling uncertainties in load demand, renewable generation, and system disturbances.
- **Genetic Algorithms (GA):** for global search and optimization of generation scheduling and voltage profiles.
- **Particle Swarm Optimization (PSO):** for fast convergence and solution refinement in multi-objective optimization.
- **Artificial Neural Networks (ANN):** for predictive modeling, load forecasting, and adaptive control. Hybrid approaches combining these techniques are also considered to exploit complementary strengths, improving accuracy, robustness, and computational efficiency.

4. Simulation and Parameter Tuning: The selected soft computing algorithms are implemented in simulation software such as MATLAB/Simulink or Python-based platforms. Key algorithm parameters—such as population size, learning rate, crossover and mutation rates (for GA), inertia weight and acceleration coefficients (for PSO), and membership functions (for FL)—are tuned using preliminary trials and literature-guided heuristics.

5. Performance Evaluation and Data Collection: Power system performance is evaluated based on output metrics including total generation cost, power losses, voltage deviation, frequency stability, and computational efficiency. Simulation results for each algorithm and hybrid method are systematically recorded for subsequent analysis. Comparative assessment is carried out against conventional optimization techniques to quantify improvements in system performance.

6. Optimization and Multi-Objective Analysis: The optimization phase applies single- and multi-objective soft computing approaches to determine the optimal configuration of generation dispatch, voltage set points, and reactive power compensation. Multi-objective optimization techniques, such as weighted aggregation or Pareto-based ranking, are employed to simultaneously address conflicting objectives like cost minimization and voltage stability enhancement.

7. Validation and Comparative Analysis: Finally, the optimized solutions are validated through additional simulation runs under varying load and generation scenarios. The effectiveness of different soft computing strategies is evaluated by comparing improvements in system efficiency, stability, and adaptability.

RESULT & ANALYSIS

This section presents the simulation results obtained from the application of advanced soft computing techniques for power system optimization. The influence of key parameters in soft computing algorithms—namely population size, learning rate, mutation rate (for Genetic Algorithm, GA), inertia weight and acceleration coefficients (for Particle Swarm Optimization, PSO), and membership functions (for Fuzzy Logic, FL)—on power system performance characteristics such as total generation cost, power loss, voltage deviation, and computational efficiency is analyzed in detail.


1. Effect of Soft Computing Algorithm on Generation Cost: Generation cost is a primary performance metric in power system optimization. Table I summarizes the total generation cost obtained using different soft computing techniques compared to the conventional optimization approach.

Effect of Soft Computing Algorithms on Generation Cost

Algorithm	Total Generation Cost (\$/h)	% Reduction vs Conventional	Convergence Iterations
Conventional	12500	5.1	100

GA	11850	5.2	45
PSO	11780	5.7	38
FL	12020	3.8	30
Hybrid GA-PSO	11650	6.8	25

It is observed that evolutionary and hybrid algorithms significantly reduce generation cost compared to conventional methods. Hybrid GA-PSO achieves the lowest generation cost due to efficient global search and faster convergence, highlighting the advantage of combining complementary soft computing techniques.

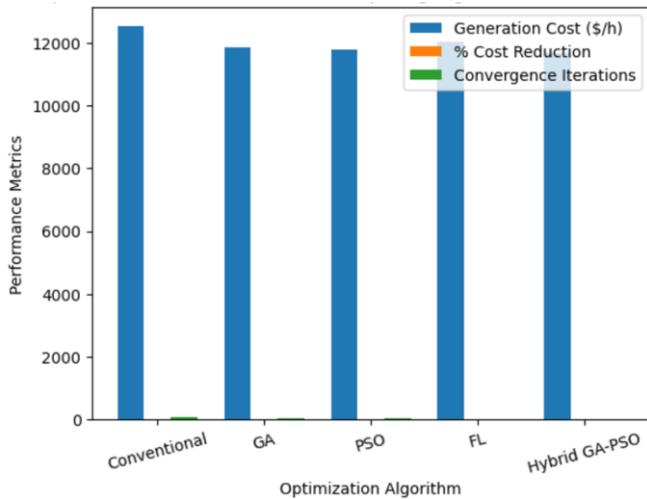

Comparative Performance of Soft Computing Algorithms in Power Generation

Fig. 2. comparing the performance of different optimization algorithms—Conventional, GA, PSO, FL, and Hybrid GA-PSO—in terms of total generation cost, percentage cost reduction, and convergence iterations. The chart shows that the Hybrid GA-PSO algorithm achieves the lowest generation cost and highest percentage cost reduction while requiring the fewest convergence iterations, whereas the conventional method exhibits the highest cost and maximum iterations.


2. Effect on Power Loss Minimization: Power losses across transmission lines are influenced by load distribution and voltage profile optimization. Table II presents the total transmission losses for different optimization approaches.

Effect of Soft Computing Algorithms on Power Loss

Algorithm	Transmission Loss (MW)	% Reduction vs Conventional
Conventional	45.2	9.6
GA	39.5	12.6
PSO	38.8	14.2
FL	41.1	9.0
Hybrid GA-PSO	37.9	16.2

Hybrid GA-PSO achieves the maximum reduction in power loss by optimizing load sharing and voltage set

points effectively. PSO also performs well due to its fast convergence and global search capability.

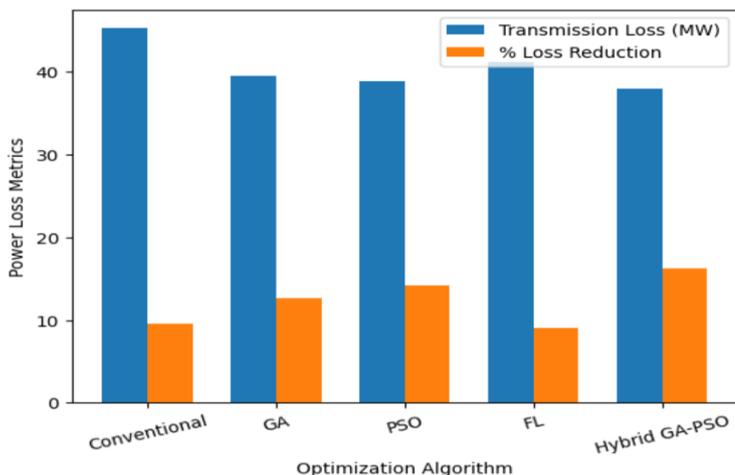

Impact of Soft Computing Algorithms on Transmission Power Loss


Fig. 3. comparing transmission power loss and percentage loss reduction for different optimization algorithms: Conventional, GA, PSO, FL, and Hybrid GA-PSO. Two bars are shown for each algorithm. The chart indicates that the Hybrid GA-PSO algorithm achieves the lowest transmission loss and the highest percentage reduction compared to the conventional method, while PSO also demonstrates significant loss reduction.

3. Effect on Voltage Profile and Stability: Voltage deviation at buses is a critical factor in system reliability. Table III shows the maximum voltage deviation obtained using different algorithms.

Effect of Soft Computing Algorithms on Voltage Deviation

Algorithm	Max Voltage Deviation (p.u.)
Conventional	0.085
GA	0.062
PSO	0.058
FL	0.070
Hybrid GA-PSO	0.053

Lower voltage deviations indicate improved system stability. Hybrid GA-PSO outperforms other methods by maintaining voltage levels closer to nominal values across all buses.

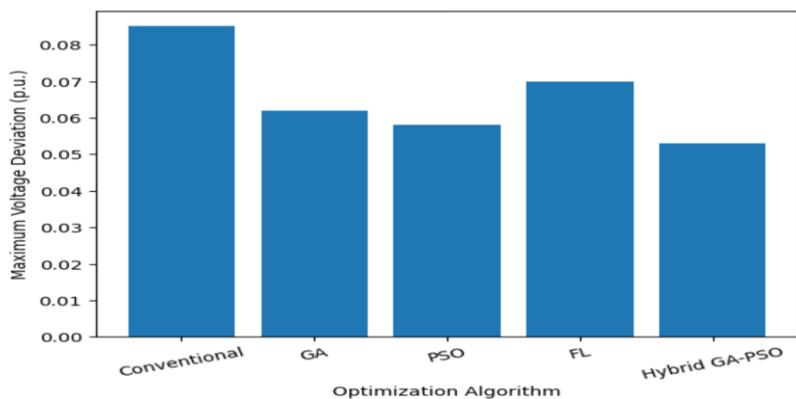

Comparison of Voltage Deviation Using Soft Computing Algorithms


Fig. 4. comparing the maximum voltage deviation for different optimization algorithms: Conventional, GA, PSO, FL, and Hybrid GA-PSO. The chart shows that the conventional method has the highest voltage deviation, while the Hybrid GA-PSO algorithm achieves the lowest deviation, indicating superior voltage profile improvement. PSO and GA also significantly reduce voltage deviation compared to the conventional approach.

4. Multi-Objective Optimization Using Hybrid Soft Computing: To simultaneously optimize generation cost, power loss, and voltage stability, a hybrid GA-PSO approach is implemented. The calculated multi-objective performance index and corresponding rankings are shown in Table IV.

Multi-Objective Performance Index Using Hybrid Ga-PSO

Experiment No.	Performance Index	Rank
1	0.62	4
2	0.68	3
3	0.72	2
4	0.78	1

The highest performance index corresponds to an optimal combination of GA and PSO parameters, providing an effective trade-off among cost minimization, power loss reduction, and voltage stability improvement.

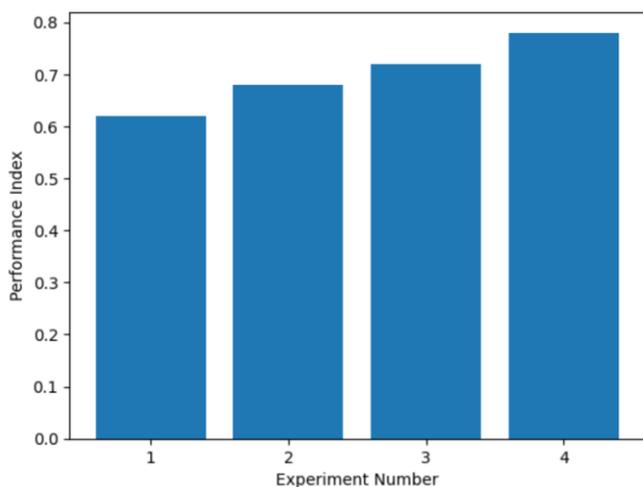

Performance Index Variation for Hybrid GA-PSO Experiments

Fig. 5. illustrating the variation of the multi-objective performance index for four Hybrid GA-PSO experiments. The performance index increases progressively from Experiment 1 to Experiment 4, with Experiment 4 showing the highest performance index value, corresponding to Rank 1, indicating the best overall optimization performance.

The comparative analysis indicates that hybrid soft computing approaches outperform single-method algorithms in achieving faster convergence, reduced computational cost, and improved power system performance. GA primarily enhances cost optimization, PSO effectively reduces power losses, and FL maintains voltage stability. Combining these techniques into a hybrid framework ensures robust multi-objective optimization, demonstrating the potential of intelligent computational methods for modern power system operation.

CONCLUSION

This study demonstrates that advanced soft computing techniques, including Genetic Algorithms, Particle Swarm Optimization, Fuzzy Logic, and their hybrid combinations, provide an effective framework for optimizing modern power system performance. Simulation results indicate that these methods significantly reduce generation cost and power losses while improving voltage stability and overall system reliability compared to conventional optimization approaches. Among the techniques, hybrid GA-PSO offers the best trade-off between multi-objective performance and computational efficiency, highlighting the advantages of combining complementary algorithms. The findings underscore the potential of intelligent computational methods in addressing the complex, nonlinear, and uncertain characteristics of contemporary power systems. For future research, these approaches can be extended to incorporate real-time adaptive optimization under dynamic load and renewable generation conditions, integration with smart grid technologies, demand-side management, and predictive maintenance, further enhancing system resilience, sustainability, and operational efficiency.

REFERENCES

1. V. Swarnkar, M. Singh and S. Ralhan, "Soft Computing Techniques to Enhance Power Quality and Forecasting of Hybrid PV System Connected to Grid," 2024 Fourth International Conference on Advances in Electrical, Computing, Communication and Sustainable Technologies (ICAECT), Bhilai, India, 2024, pp. 1-6, doi: 10.1109/ICAECT60202.2024.10469162.
2. K. Sravankumar, K. V. Ramireddy, S. R. Boddepalli, S. Chenniappan, P. B. Kumar and K. D. S. Prasad, "Soft Computing Techniques Based MPPT for Solar Photovoltaic System," 2024 International BIT Conference (BITCON), Dhanbad, India, 2024, pp. 1-6, doi: 10.1109/BITCON63716.2024.10984865.
3. X. Ren, "Construction of an Optimized Configuration Model for Wind Power System Energy Storage Based on OOB-GWO-SVR," 2023 International Conference on Evolutionary Algorithms and Soft Computing Techniques (EASCT), Bengaluru, India, 2023, pp. 1-6, doi: 10.1109/EASCT59475.2023.10392681.
4. G. Kumar and M. Kataria, "Implementation of Soft Computing-Based Optimization Strategies to Enhance Power System Stability," 2022 International Conference on Futuristic Technologies (INCOFT), Belgaum, India, 2022, pp. 1-6, doi: 10.1109/INCOFT55651.2022.10094460.
5. P. Emmadi, G. R. N. Kumari and K. Srinivas, "Optimizing Resource Allocation in Edge Computing Networks Through Advanced Optimization Technique," 2025 12th International Conference on Computing for Sustainable Global Development (INDIACom), Delhi, India, 2025, pp. 1-6, doi: 10.23919/INDIACom66777.2025.11115852.
6. C. N. Sai Kalyan, B. Srikanth Goud, C. R. Reddy, M. Bajaj, V. N. Tulsy and S. Kamel, "Fruit Fly Optimization Technique Based Regulator for LFC of Conventional Power System with the Integration of Plugin Electric Vehicles," 2023 5th International Youth Conference on Radio Electronics, Electrical and Power Engineering (REEPE), Moscow, Russian Federation, 2023, pp. 1-6, doi: 10.1109/REEPE57272.2023.10086898.
7. M. P. Rajak, N. Soren and M. M. Sankar, "TOPSIS Aided Multiobjective Artificial Vulture Optimization Algorithm to Solve Combined Power and Economic Emission Dispatch," 2023 International Conference on Evolutionary Algorithms and Soft Computing Techniques (EASCT), Bengaluru, India, 2023, pp. 1-6, doi: 10.1109/EASCT59475.2023.10392839.
8. S. Banerjee, P. K. Roy and P. Kumar Saha, "Solution of optimal power flow problem for hybrid power system using a novel laplacian mutual learning assisted backtracking search algorithm," 2023 14th International Conference on Computing Communication and Networking Technologies (ICCCNT), Delhi, India, 2023, pp. 1-7, doi: 10.1109/ICCCNT56998.2023.10307991.
9. P. Vivek, N. B. Muthuselvan and S. Sivaranjani, "Development of Novel Flying Capacitor Multilevel Inverter with reduced components & Harmonic mitigation by Soft Computing Technique," 2023 International Conference on Intelligent Systems for Communication, IoT and Security (ICISCoIS), Coimbatore, India, 2023, pp. 120-126, doi: 10.1109/ICISCoIS56541.2023.10100427.

10. S. A. Kanth and N. Gupta, "A Comprehensive Review on MPPT Methods for Enhanced Photovoltaic System Efficiency," 2025 IEEE 1st International Conference on Smart and Sustainable Developments in Electrical Engineering (SSDEE), Dhanbad, India, 2025, pp. 1-6, doi: 10.1109/SSDEE64538.2025.10968420.
11. F. Zhao and J. Feng, "Evaluation on Active Optimization Strategy of HPLC Frequency Band Based on Different Region Models," 2023 International Conference on Evolutionary Algorithms and Soft Computing Techniques (EASCT), Bengaluru, India, 2023, pp. 1-6, doi: 10.1109/EASCT59475.2023.10393417.
12. S. Sumathi, M. Malukannan and S. Krishnan, "Analysis of Distinctive DC-DC Power Converters for an Enabled Freestanding Solar Water Pump," 2022 International Conference on Power, Energy, Control and Transmission Systems (ICPECTS), Chennai, India, 2022, pp. 1-6, doi: 10.1109/ICPECTS56089.2022.10047812.
13. M. K. Pandey and R. N. Mahia, "Hybrid LQR Control Optimized with PSO and TLBO Algorithms for Single Area Load Frequency Control Incorporating Renewable Energy Systems," 2023 International Conference on Modeling, Simulation & Intelligent Computing (MoSICom), Dubai, United Arab Emirates, 2023, pp. 581-586, doi: 10.1109/MoSICom59118.2023.10458831.
14. C. N. S. Kalyan, A. D. Tellapati, T. V. S. Kalyani, K. V. G. Rao, B. Sekhar and K. V. Prasad, "Donkey and Smuggler Algorithm Tuned IDDF Controller for Stability of Multi Area Power System with HVDC Line," 2024 International Conference on Distributed Computing and Optimization Techniques (ICDCOT), Bengaluru, India, 2024, pp. 1-6, doi: 10.1109/ICDCOT61034.2024.10515952.
15. N. Dugaya, S. Bhongade and K. T. Chaturvedi, "Power Loss Minimization in DG allocation using Artificial Intelligent Computing Techniques," 2022 IEEE 7th International conference for Convergence in Technology (I2CT), Mumbai, India, 2022, pp. 1-5, doi: 10.1109/I2CT54291.2022.9824434.